

KB510 SERIES

IMPORTANT SAFEGUARDS


When using electrical equipment, basic safety precautions should always be followed, including the following:

THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED. CE PRODUIT DOIT ÊTRE INSTALLÉ SELON LE CODE D'INSTALLATION PERTINENT, PAR UNE PERSONNE QUI CONNAÎT BIEN LE PRODUIT ET SON FONCTIONNEMENT AINSI QUE LES RISQUES INHÉRENTS. DISCONNECT POWER TO ALL CIRCUITS BEFORE WIRING FIXTURE. INSTALL IN ACCORDANCE WITH ALL NATIONAL, STATE, AND LOCAL CODES. DO NOT CONNECT TO AN UNGROUNDED SUPPLY. READ ALL FIXTURE MARKINGS AND LABELS TO ENSURE CORRECT INSTALLATION OF FIXTURE. SUPPLEMENTAL INSTRUCTIONS MAY BE LOCATED ON THE FIXTURE, IN ADDITION TO THIS INSTRUCTION SHEET, REGARDING ORIENTATION, OR MOUNTING RESTRICTIONS.

SAVE THESE INSTRUCTIONS

INSTALLATION

1. Attach input leads to fixture as shown in Fig.1 for 24VDC input or for 120-277VAC input.
2. Mount fixture over recessed wiring box tucking wiring into wiring box.
3. Secure to wall over bolts and secure with nuts or using screws (mounting hardware by others).

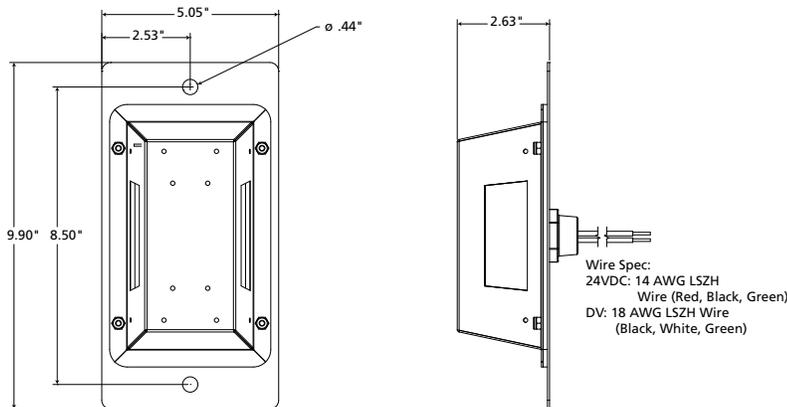

Connect:

For 24DC Fixture-
Red to (+) 24VDC
Black to (-) 24VDC
Green to Ground

For 120-277VAC Fixture-
Black to 120-277VAC
White to Neutral
Green to Ground


SERVICE

Before beginning any service operation, be sure the power to the fixture is off.





DRIVER REPLACEMENT

1. Remove (4) locknuts and remove the housing from the mounting plate.
2. Disconnect the wiring from the driver or driver board.
3. Remove (2) screws securing the driver.
4. Install the new driver reversing the previous steps.

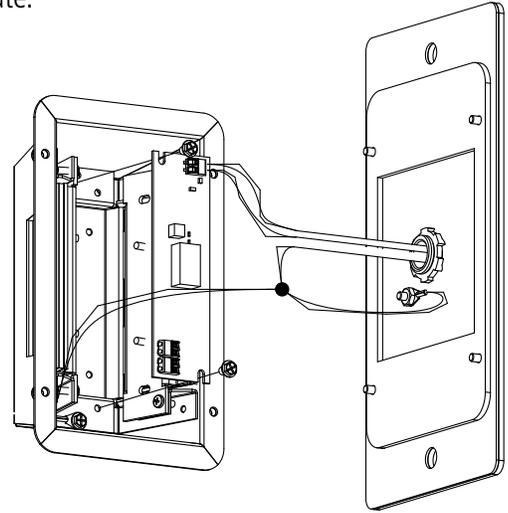

WIRING DIAGRAMS

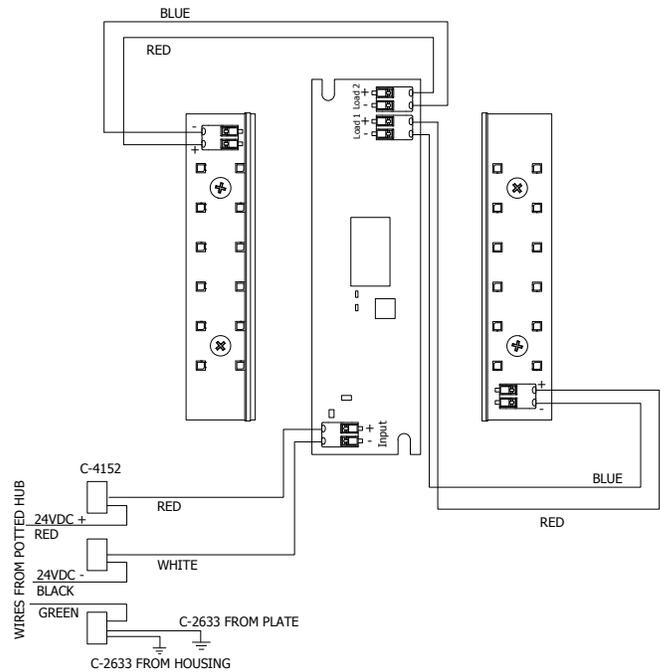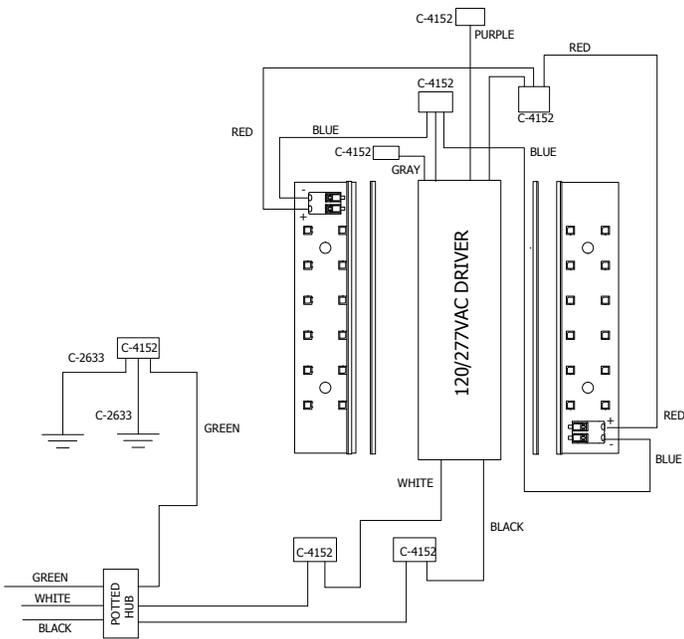

CUSTOMER SERVICE

For technical assistance, call 1-800-4KENALL (1-800-453-6255).

WARRANTY

For warranty information visit www.kenall.com/Resources/Certified-Performance-Warranties

